


RH, %

Kaarma kiriku sisekliima, 01.01.2014 - 01.11.2018,

temp, °C

dataloger EL-USB-2 Plus, temp ± 0,3 °C, RH ± 2,0 %

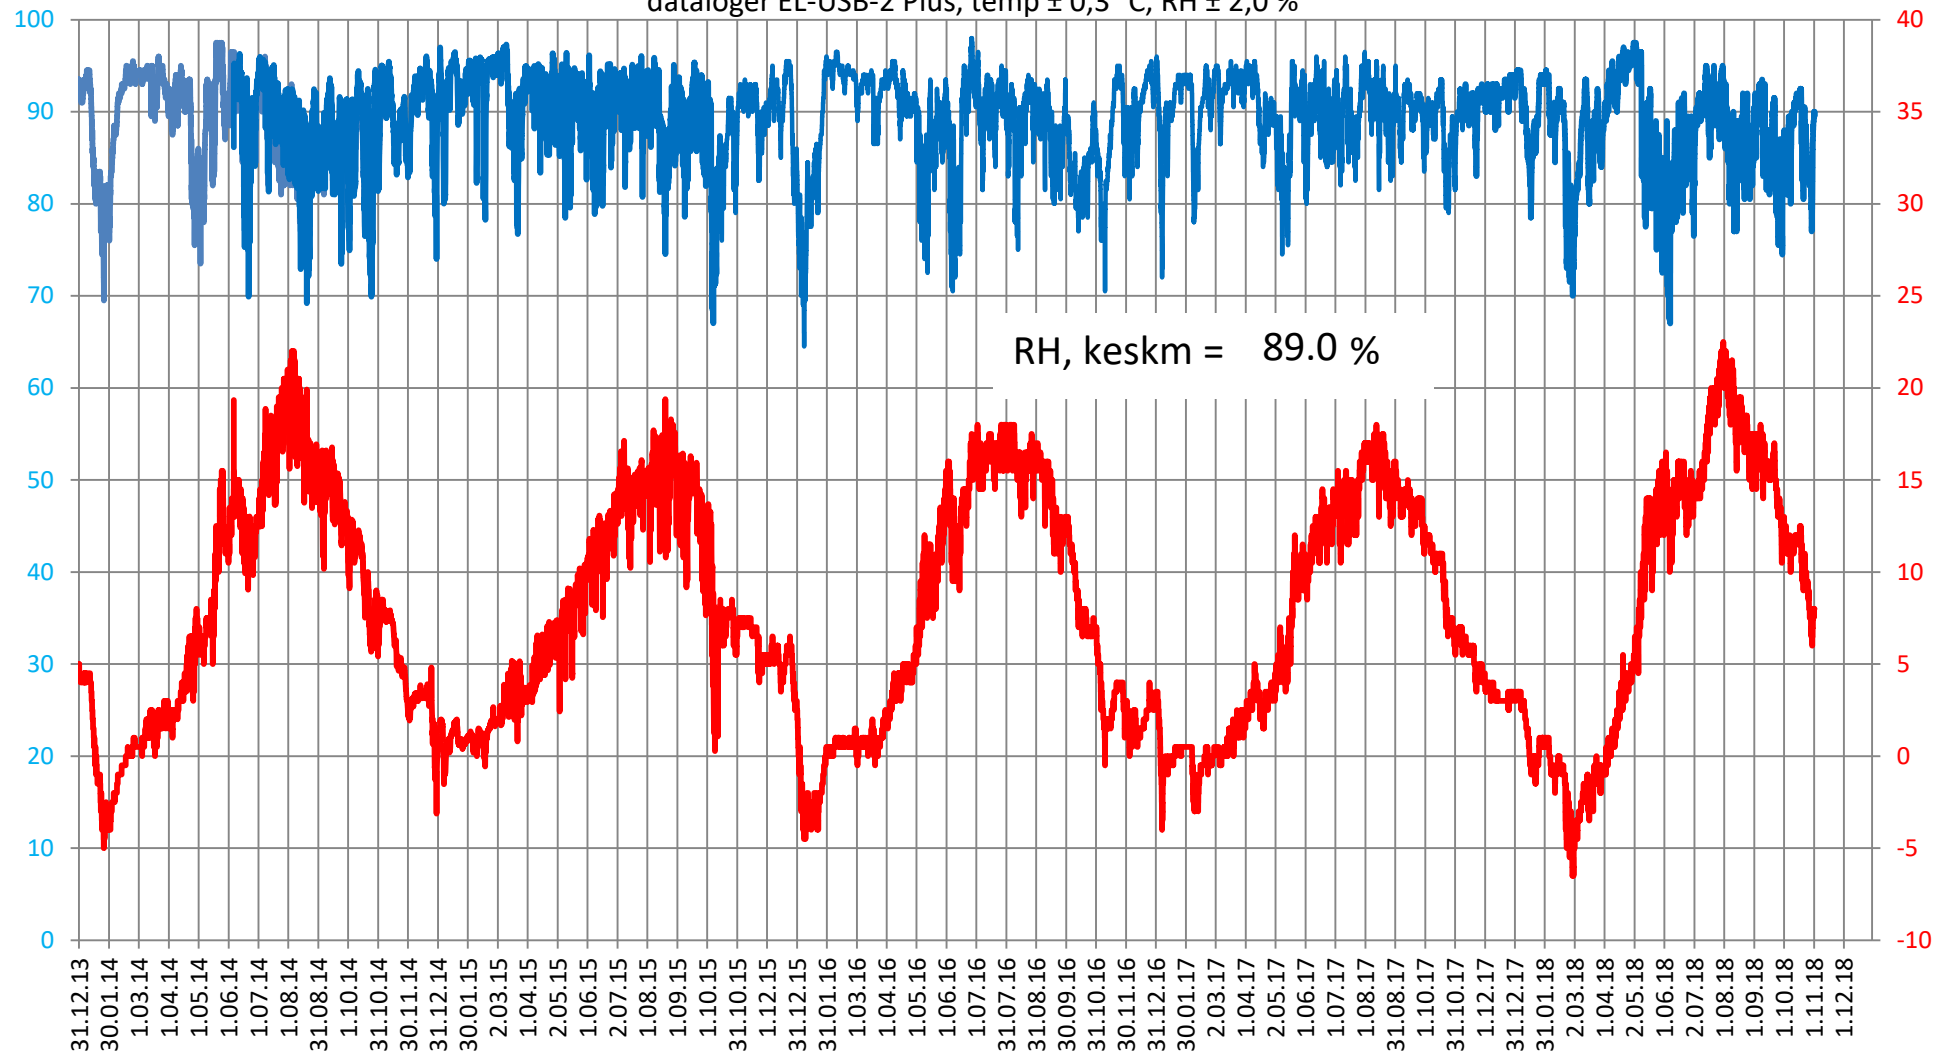

— RH, % — Temp, °C

Lembit.Kurik@ttu.ee