


RH, %

Kaarma kiriku sisekliima, 14.10.2015 - 6.11.2017,

temp, °C

dataloger EL-USB-2 Plus, temp ± 0,3 °C, RH ± 2,0 %

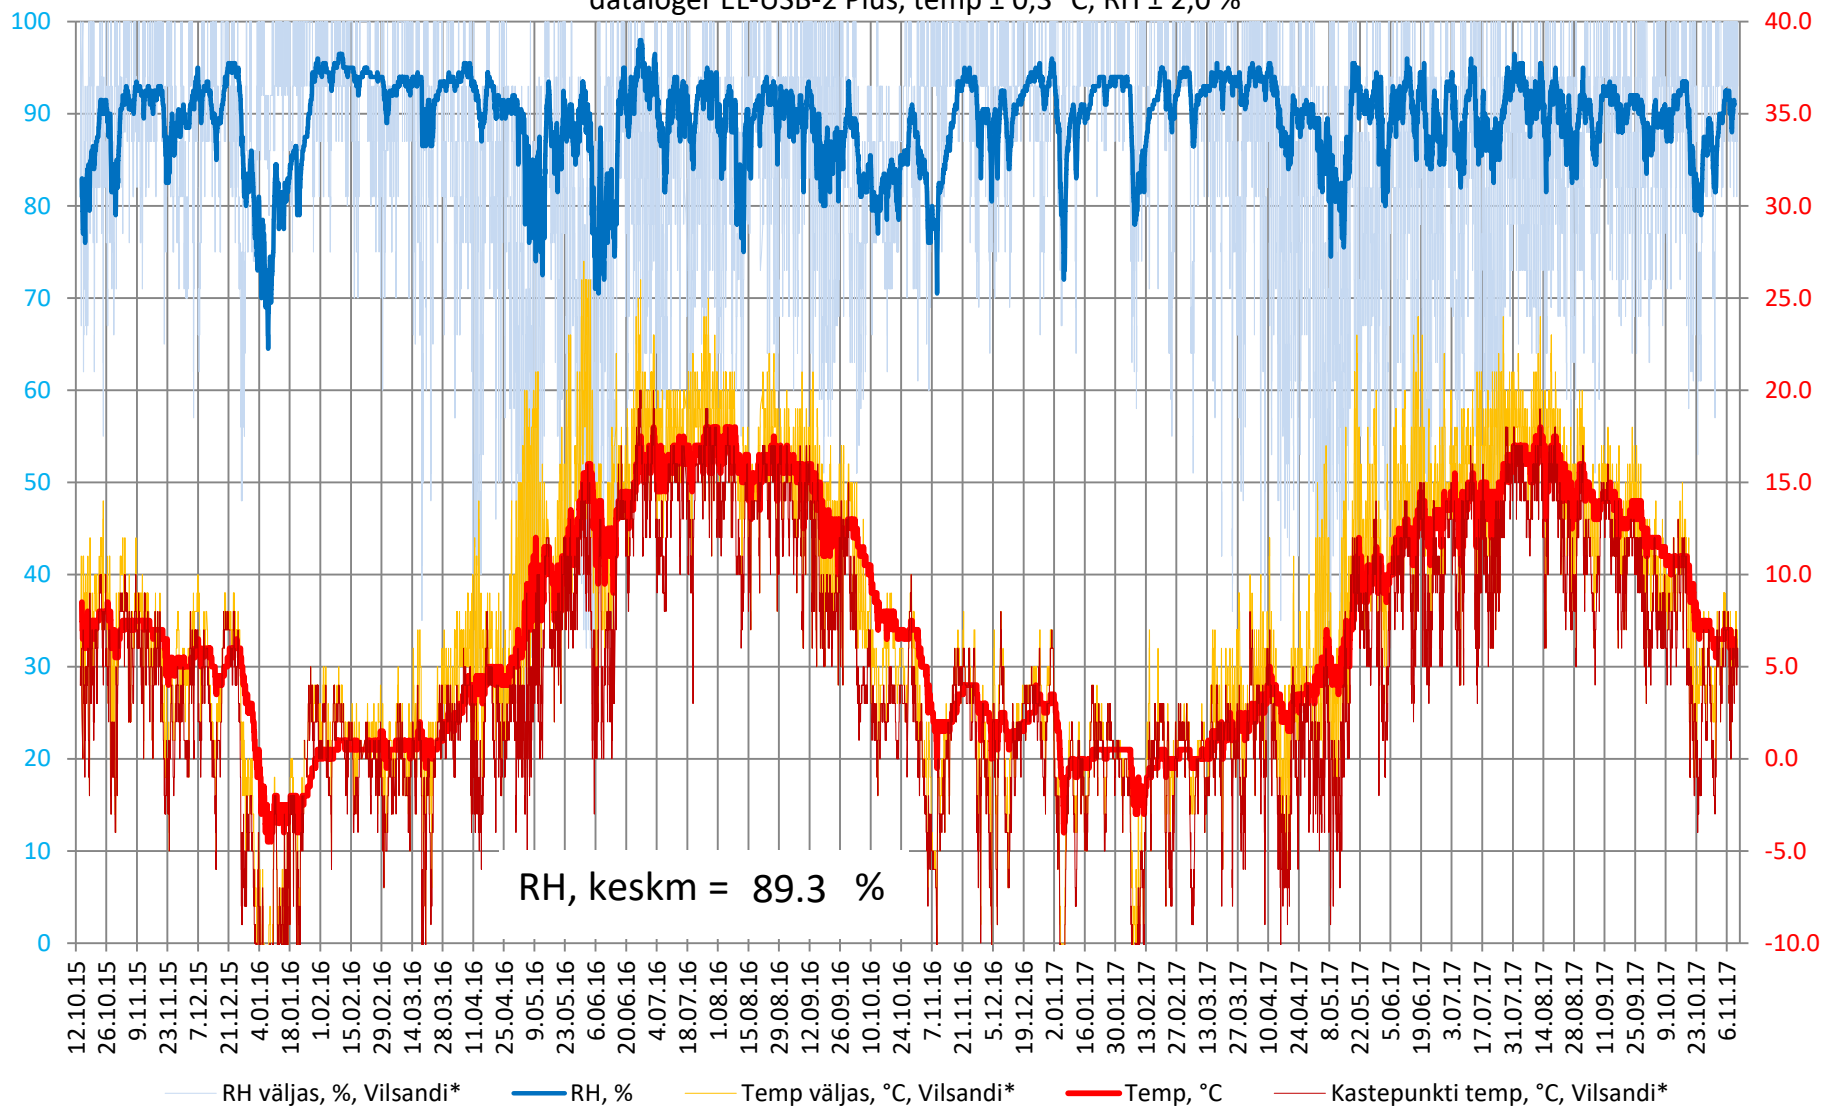

*rp5.ru

Lembit Kurik, Tallinna Tehnikaülikool, Lembit.Kurik@ttu.ee